

Current Data Parameters
 NAME GLP28
 EXPNO 10
 PROCNO 1

F2 - Acquisition Parameters

INSTRUM spect
 PROBHD z116098_0564 (
 PULPROG zg30
 TD 65536
 SOLVENT D2O
 NS 16
 DS 2
 SWH 8012.820 Hz
 FIDRES 0.244532 Hz
 AQ 4.0894465 sec
 RG 88.08
 DW 62.400 usec
 DE 6.50 usec
 TE 300.0 K
 D1 1.00000000 sec
 TD0 1
 SFO1 400.1324708 MHz
 NUC1 1H
 P1 9.84 usec
 PLW1 14.56099987 W

F2 - Processing parameters

SI 65536
 SF 400.1300000 MHz
 WDW EM
 SSB 0
 LB 0.30 Hz
 GB 0
 PC 1.00

成都普菲德生物科技有限公司
 http://www.sc-victory.com

GLP28

174.26
173.12
172.20
156.84
156.81
130.44
130.39
129.64
129.61
116.73
116.71
100.28
76.06
75.54
72.88
70.31
69.36
67.21
60.51
52.43
46.68
44.96
31.98



Current Data Parameters


NAME GLP28
EXPRO 11
PROCNO 1

F2 - Acquisition Parameters

INSTRUM spect
PROBHD z116098_0564 (
PULPROG zgpg30
TD 65536
SOLVENT D2O
NS 500
DS 4
SWH 24038.461 Hz
FIDRES 0.733596 Hz
AQ 1.3631488 sec
RG 198.68
DW 20.800 usec
DE 6.50 usec
TE 300.0 K
D1 2.00000000 sec
D11 0.03000000 sec
TD0 1
SFO1 100.6228298 MHz
NUC1 13C
P1 10.53 usec
PLW1 69.16899872 W
SFO2 400.1316005 MHz
NUC2 1H
CPDPRG[2] waltz16
PCPD2 90.00 usec
PLW2 14.56099987 W
PLW12 0.17406000 W
PLW13 0.08755000 W

F2 - Processing parameters

SI 32768
SF 100.6127685 MHz
WDW EM
SSB 0
LB 1.00 Hz
GB 0
PC 1.40

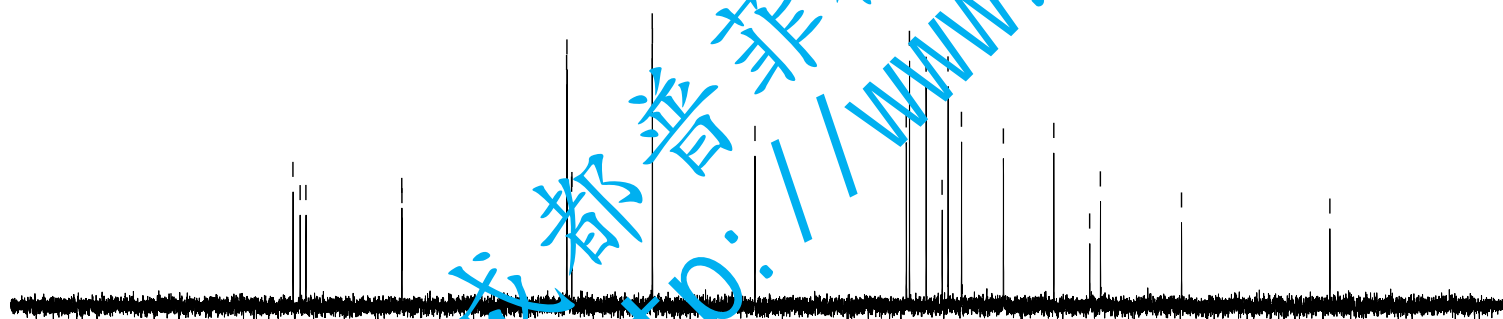

200 180 160 140 120 100 80 60 40 20 0 ppm

成都普菲德生物科技有限公司
http://www.sc-victory.com